


- GENERAL NOTES:
1. FOR TANK DIMENSIONAL VALUES SEE "WATER & TREATMENT TANK GENERAL DIMENSIONS" DRAWING NO. 261375.
 2. FOR FOUNDATION CONFIGURATIONS AND CORRESPONDING CONSTRUCTION MATERIAL REQUIREMENTS REFER TO THE PROJECT SUBMITTAL DOCUMENTATION.

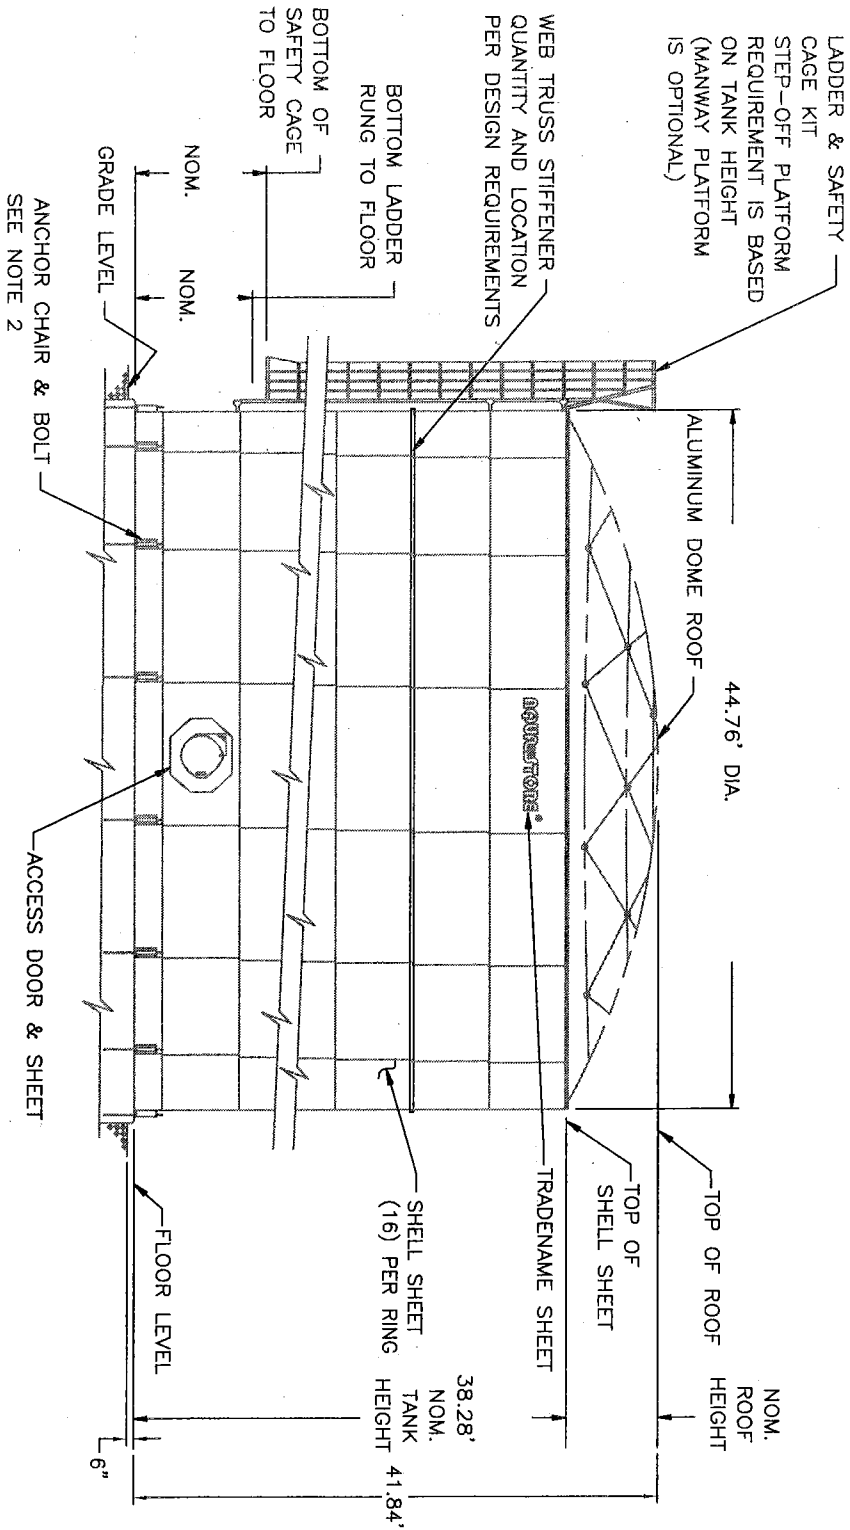

REV	DESCRIPTION
1	RELEASED FOR M/I MARKETING SALES & PRE-SUBMITTAL USAGE 5-8-90, RKK
2	REVISED GENERAL NOTES AND LABELS, REVISED ANCHOR CHAIR POSITIONS, 1-2-91, RKK
3	REVISED NOTE 2 ECN 98172, 09/11/98, MCA/
4	CHANGED GLASS FLOOR TO STEEL FLOOR, ECN 99179, 09/01/99 JTF/
5	REVISED COMPANY NAME ECN 01100, 5/24/01 DMA


EQUALIZATION TANK
 17030-T-01
 17030-T-02

NEW ENGLAND TANK
 BECKETT, BILBONIS, 991118
CONFIDENTIAL
 THIS DRAWING IS THE PROPRIETARY PROPERTY OF NEW ENGLAND TANK AND IS NOT TO BE REPRODUCED WITHOUT THE EXPRESS WRITTEN CONSENT OF THE COMPANY. ALL RIGHTS RESERVED.
 EPC COMPANY © 2001

AMGEN, RI
 WWTP
 STORAGE TANKS
 NEW ENGLAND TANK
 45'DIA.X38'HT.

DRWG NO. SWA-261365

- GENERAL NOTES:
1. FOR TANK DIMENSIONAL VALUES SEE "WATER & TREATMENT TANK GENERAL DIMENSIONS" DRAWING NO. 261375.
 2. FOR FOUNDATION CONFIGURATIONS AND CORRESPONDING CONSTRUCTION MATERIAL REQUIREMENTS REFER TO THE PROJECT SUBMITTAL DOCUMENTATION.

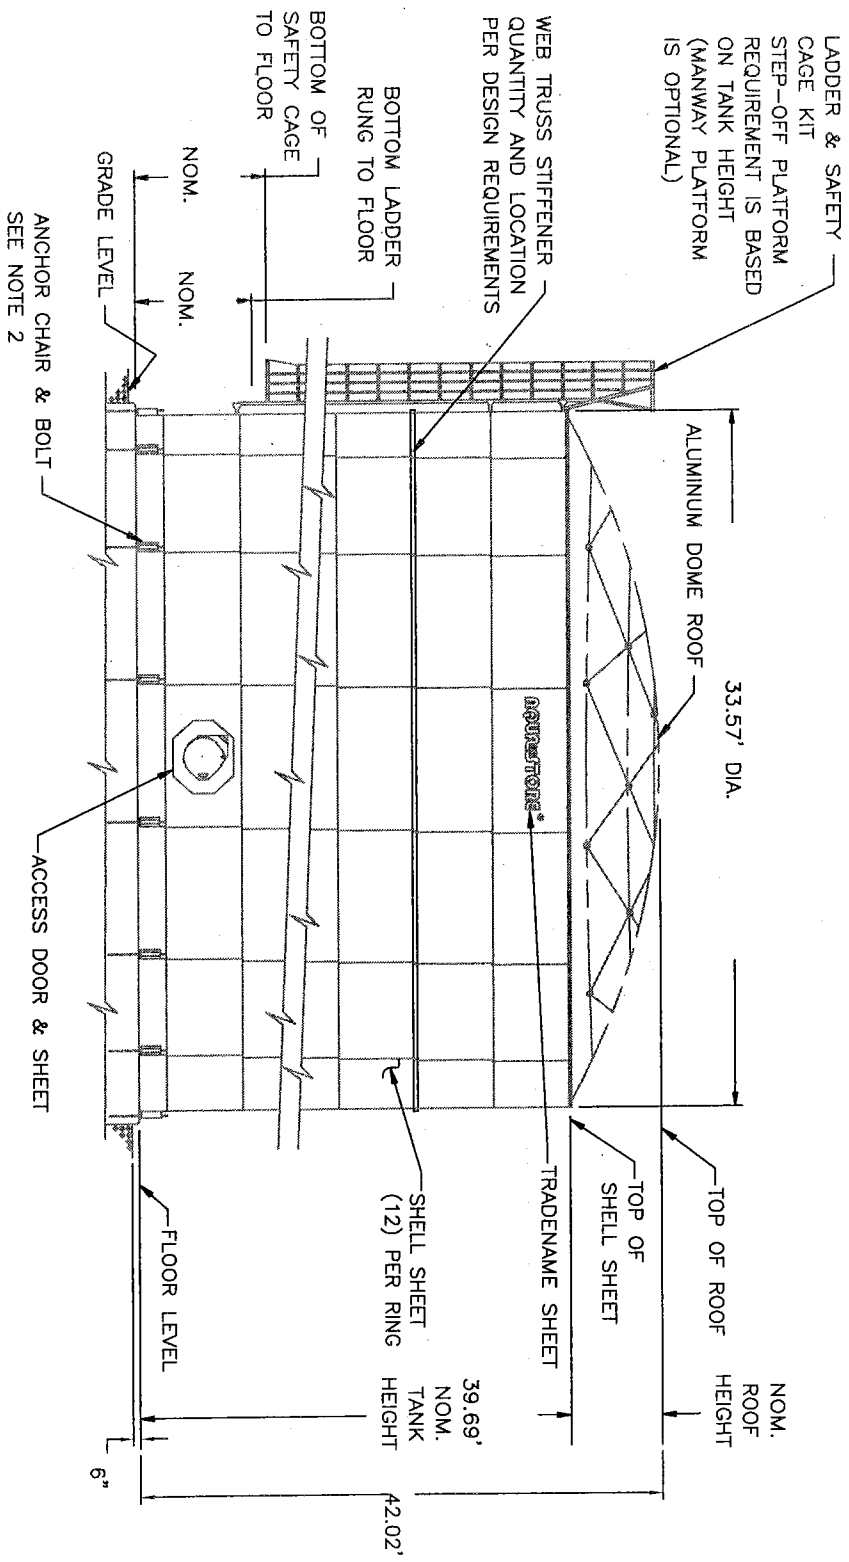

REV	DESCRIPTION
1	RELEASED FOR W/I MARKETING SALES & PRE-SUBMITTAL USAGE 5-9-90, RKK
2	REVISED GENERAL NOTES AND LABELS, REVISED ANCHOR CHAIR POSITIONS: 1-2-91, RKK
3	REVISED NOTE 2 ECN 98172, 08/11/98, MCA/
4	CHANGED GLASS FLOOR TO STEEL FLOOR, ECN 98170, 09/01/99 JTF/
5	REVISED COMPANY NAME ECN 01109, 5/24/01 DMA

CUB SURGE TANK
17020-T-01

NEW ENGLAND TANK

AMGEN, RI
WWTP
STORAGE TANKS
NEW ENGLAND TANK
34'DIA.X40'HT.

DRWG NO. SWA 261365

SCALE: BLANKS 90116
CONFIDENTIAL
THIS DRAWING IS THE PROPERTY OF THE COMPANY AND SHALL NOT BE USED FOR ANY OTHER PROJECT WITHOUT THE EXPRESS WRITTEN CONSENT OF THE COMPANY.
REPO COPYRIGHT © 2001
ALL RIGHTS RESERVED

New England Tank, Inc.

6006 DROTT DRIVE, EAST SYRACUSE, NEW YORK, 13057
 1-800-426-8265 EMAIL: info@newenglandtank.com FAX: 315-433-5083

PROPOSAL FOR:
SIX (6) AQUASTORE® WASTEWATER/STORMWATER TANKS
EACH WITH A GLASS-FUSED-TO-STEEL FLOOR PLACED ON
CONCRETE FLOOR FOUNDATION (BY OTHERS)

(No Site Work, No Ringwall or Concrete Floor Work, No Piping Work, No Secondary Containment Work)
 Non-Union, Private Wage Project

November 20, 2006

TO: Brian C. Fugere
 Sr. Director Of Purchasing
 Skanska USA Building Inc.
 401-461-8265 x-231
 Amgen - Wastewater Treatment Facility & Storm Water Storage Tanks
 West Greenwich, RI
 Bid Date: Wednesday, November 29, 2006; 2:00 P.M.

This Proposal is offered to Skanska USA Building Inc. by New England Tank, Inc. for Six (6) Aquastore® Wastewater tanks each with a Glass-Fused-To-Steel Floor placed on a Concrete Floor Foundation, constructed by others, as specified herein for installation at the New Amgen Wastewater Treatment Facility in West Greenwich, RI.

Reference:

1. Exhibit A Supplement from Skanska.
2. Specifications Section 13203 - Glass Coated Bolted Steel Tanks dated 10/31/06.
3. Drawings from Detail Design Progress Submittal dated 11/14/06.

Equipment: (As Specified)

Offered are the following tanks:

Number of Tanks	Model	Nominal Capacity in Gallons	Usable Capacity w/Freeboard	Freeboard Inches Included	Liquid Depth in Feet	Diameter in Feet	Sidewall Height in Feet	Roof** Height in Inches	Tank Floor to Grade	Overall Height from Grade
Two	EQ	450,500	403,400	48"	34.28'	44.76'	38.28'	42.7"	.5 FT	42.34 FT
One	CUB	262,700	256,100	12"	38.69'	33.57'	39.69'	28.0"	.5 FT	42.52 FT
One	Sludge	62,100	60,500	12"	36.57'	16.78'	37.57'	89.625"	.5 FT	45.54 FT
One	Effluent	17,600	15,300	24"	13.36'	13.99'	15.36'	83.5"	.5 FT	22.82 FT
One	Storm	17,600	15,300	24"	13.36'	13.99'	15.36'	83.5"	.5 FT	22.82 FT