TB
PN 6018

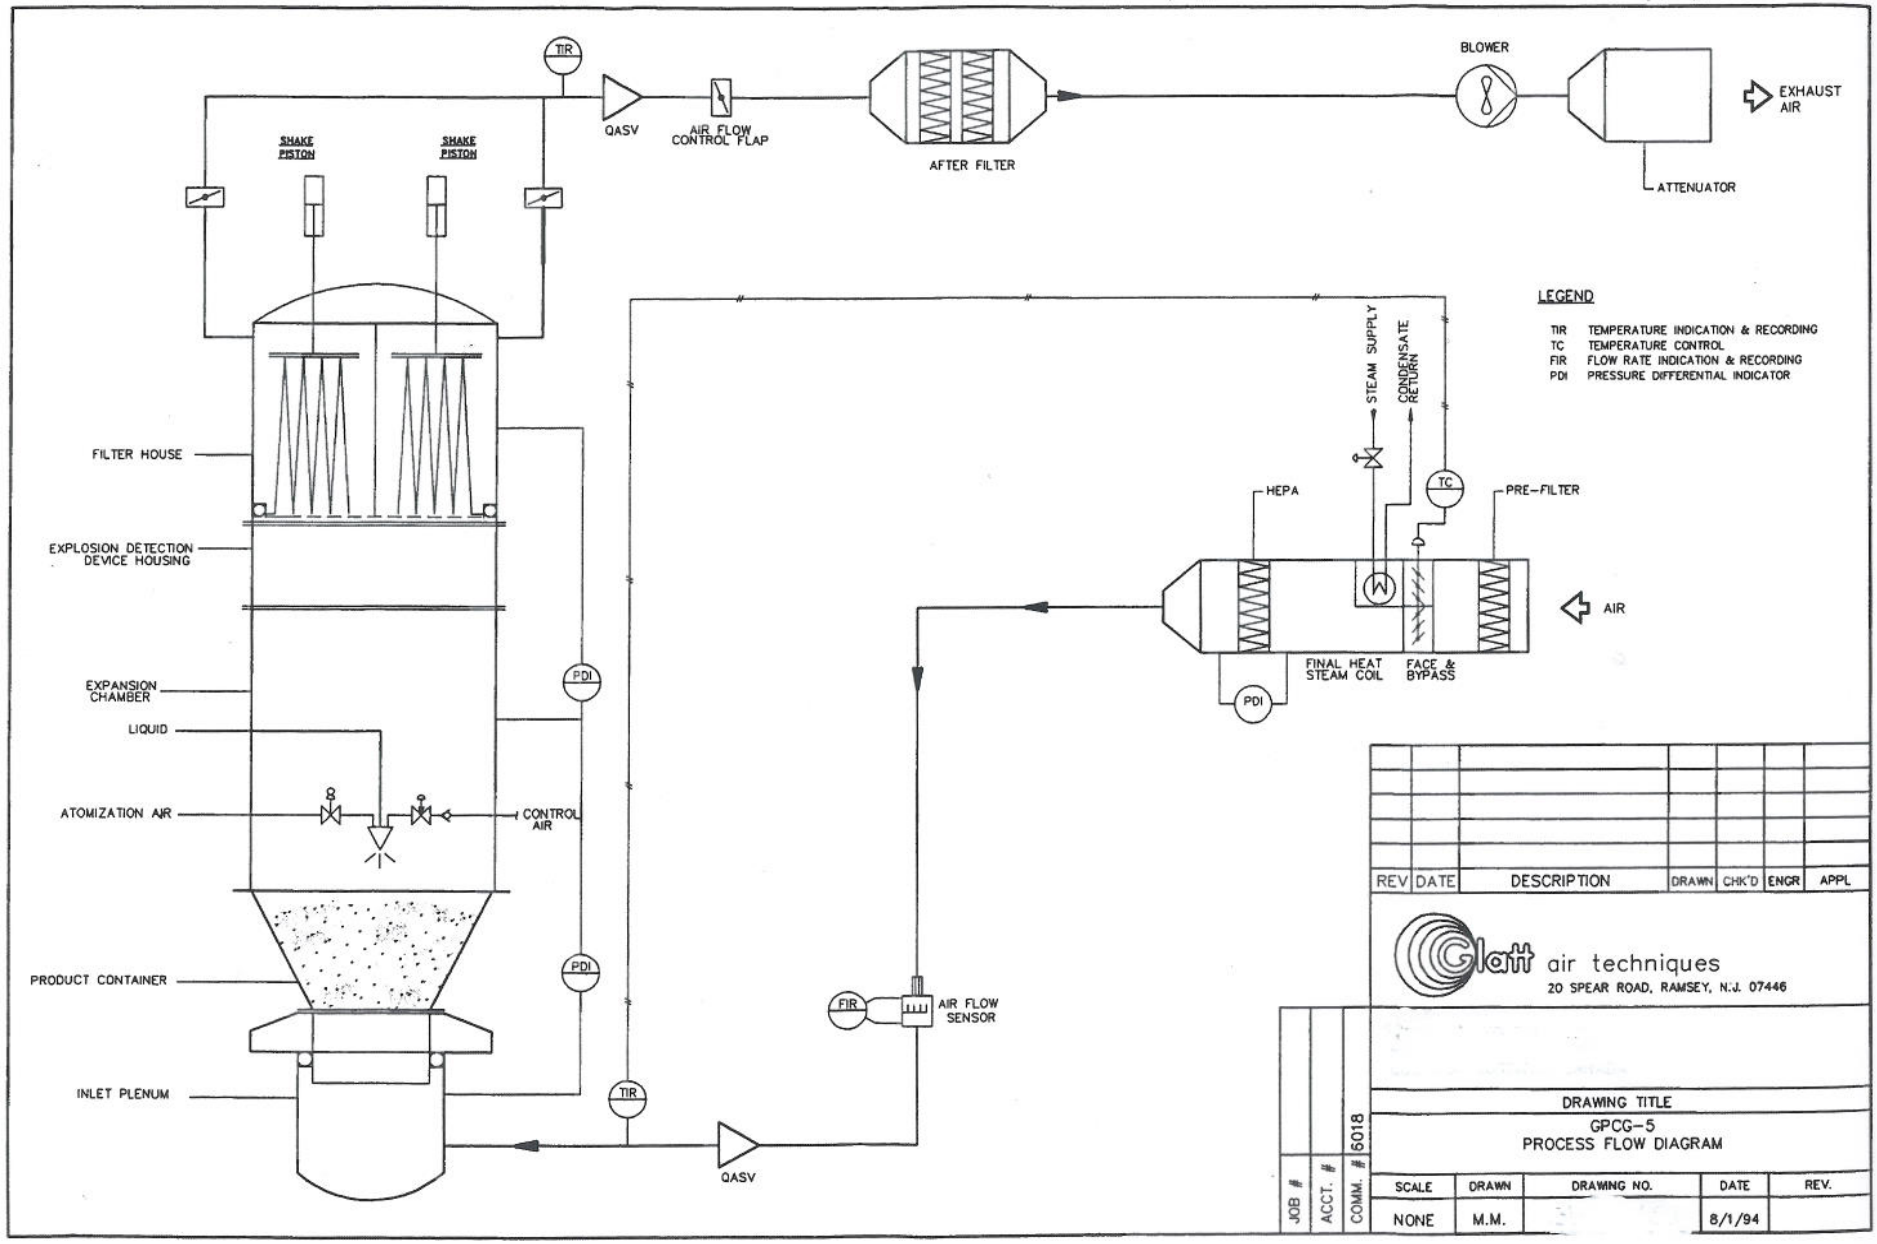
TIR
QASV
AIR FLOW CONTROL FLAP
AFTER FILTER
BLOWER
EXHAUST AIR
ATTENUATOR
SHAKE PISTON
SHAKE PISTON
FILTER HOUSE
EXPLOSION DETECTION DEVICE HOUSING
EXPANSION CHAMBER
LIQUID
ATOMIZATION AIR
CONTROL AIR
PRODUCT CONTAINER
INLET PLENUM
PDI
PDI
TIR
QASV
FIR
AIR FLOW SENSOR
STEAM SUPPLY
CONDENSATE RETURN
TC
HEPA
PRE-FILTER
FINAL HEAT STEAM COIL
FACE & BYPASS
PDI
AIR
LEGEND
TIR TEMPERATURE INDICATION & RECORDING
TC TEMPERATURE CONTROL
FIR FLOW RATE INDICATION & RECORDING
PDI PRESSURE DIFFERENTIAL INDICATOR
REV
DATE
DESCRIPTION
DRAWN
CHK'D
ENGR
APPL
Glatt air techniques
20 SPEAR ROAD, RAMSEY, N.J. 07446
JOB #
ACCT. #
COMM. # 6018
DRAWING TITLE
GPCG-5
PROCESS FLOW DIAGRAM
SCALE
DRAWN
DRAWING NO.
DATE
REV.
NONE
M.M.
8/1/94